



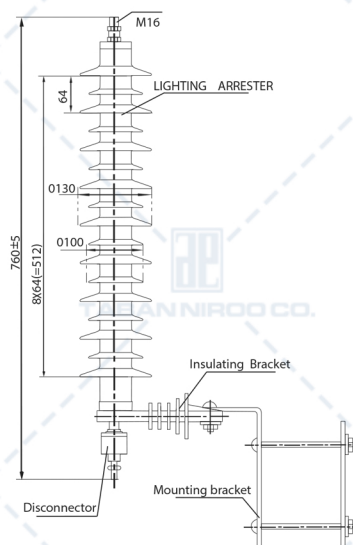

TABAN NIROO CO.

DENA POWER LINE INSULATORS

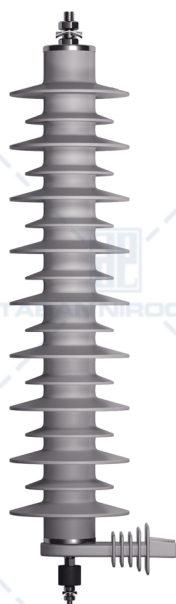

SURGE ARRESTER DISTRIBUTION CLASS

DESCRIPTION	24KV/10KA	36KV/10KA
TYPE	CLASS-1	CLASS-1
STANDARD	IEC60099-4 OR ANSI C62,11	IEC60099-4 OR ANSI C62,11
ARRESTER RATING KV	24	36
M.C.O.V. KV	19.5	29
RATED FREQUENCY HZ	50-60	50-60
MAX.RESIDUAL VOLTAGE (8.20us) 10KA KV	75	110
INSULATION WITHSTAND VOLTAGE 1,2/50 IMPULSE KV	125/150	170
POWER FREQUENCY WITHSTAND VOLTAGE KV	50	70
HIGH CURRENT IMPULSE WITHSTAND KA	100	100
GREEPAGE DISTANCE mm	850	1340
ACCESSORIES	YES	
GROUND LEAD DISCONNECTOR	YES	
INSULATOR BRACKET	YES	
NEMA CROSS ARM BRACKET	YES	
LINE TERMINAL WITH STAINLESS STEEL WIRE CLAMP & NUT	YES	
GROUND TERMINAL WITH STAINLESS STEEL WIRE CLAMP & NUT	YES	



According to IEC60099-4 (2001-2012) & IEC62217 (2005)